

## Notice: Variation of Permit

This permit has been varied by the Scottish Environment Protection Agency (SEPA) in exercise of its powers under Regulation 46 of the Pollution Prevention and Control (Scotland) Regulations 2012 (“the Regulations”). The terms used in this notice, unless otherwise defined, have the same meaning as in the Regulations.

<b>Permit Number:</b>	PPC/W/0020057
<b>Site address:</b>	Dunbia Highland Meats Blakely Road Saltcoats KA21 5JQ
<b>Operator:</b>	Dunbia Highland Meats Company Number – 03382084 Dunbia (UK) Michael House, Castle Street, Exeter, EX4 3LQ
<b>Variation Number:</b>	VAR01
<b>Effective Date of Variation:</b>	27 March 2023
<b>Details of Variation:</b>	The permit is varied as specified in the Schedule attached.

PAGE INTENTIONALLY LEFT BLANK

Permit Number: PPC/W/0020057


## Schedule

The permit has been varied as follows:

1. Condition 1.1.5.12 has been deleted and replaced by a new condition 1.1.5.12, as follows:
  - 1.1.5.12 Collection and treatment of all waste water from processing activities, wash down and hygiene activities, more particularly described below:
    - (a) screening of solids;
    - (b) one 716m<sup>3</sup> effluent storage tank;
    - (c) one 55m<sup>3</sup> sludge storage tank with carbon filter;
    - (c) chemical treatment via Dissolved Air Flotation (DAF);
    - (e) discharge of treated effluent to public sewer after sampling point.


- 2. Condition 1.2 Site Plan has been deleted and replaced by a new condition 1.2 Site Plan, as follows:

**1.2 Site Plan**

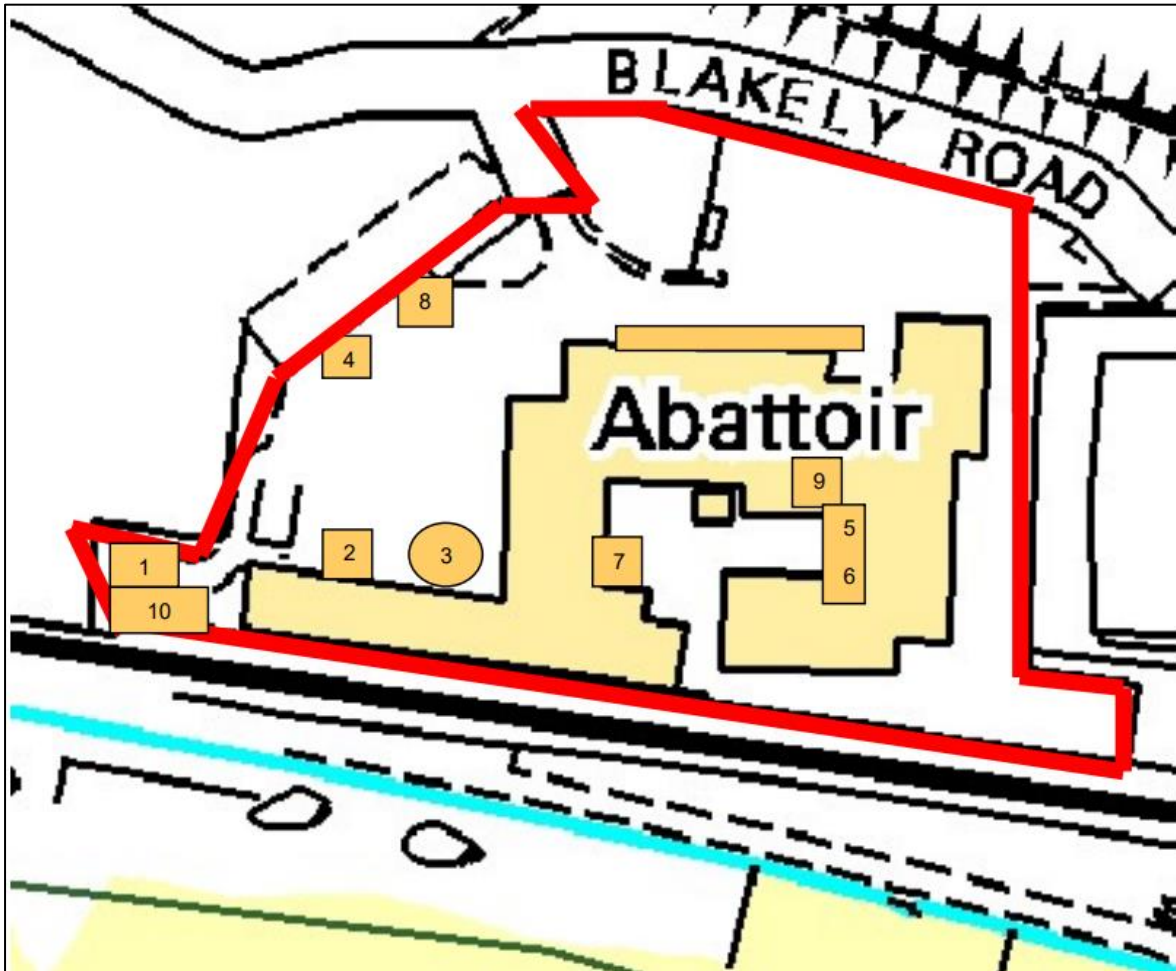

3. Condition 1.3 Location Plan has been deleted and replaced by a new condition 1.3 Location Plan, as follows:

### 1.3 Location Plan

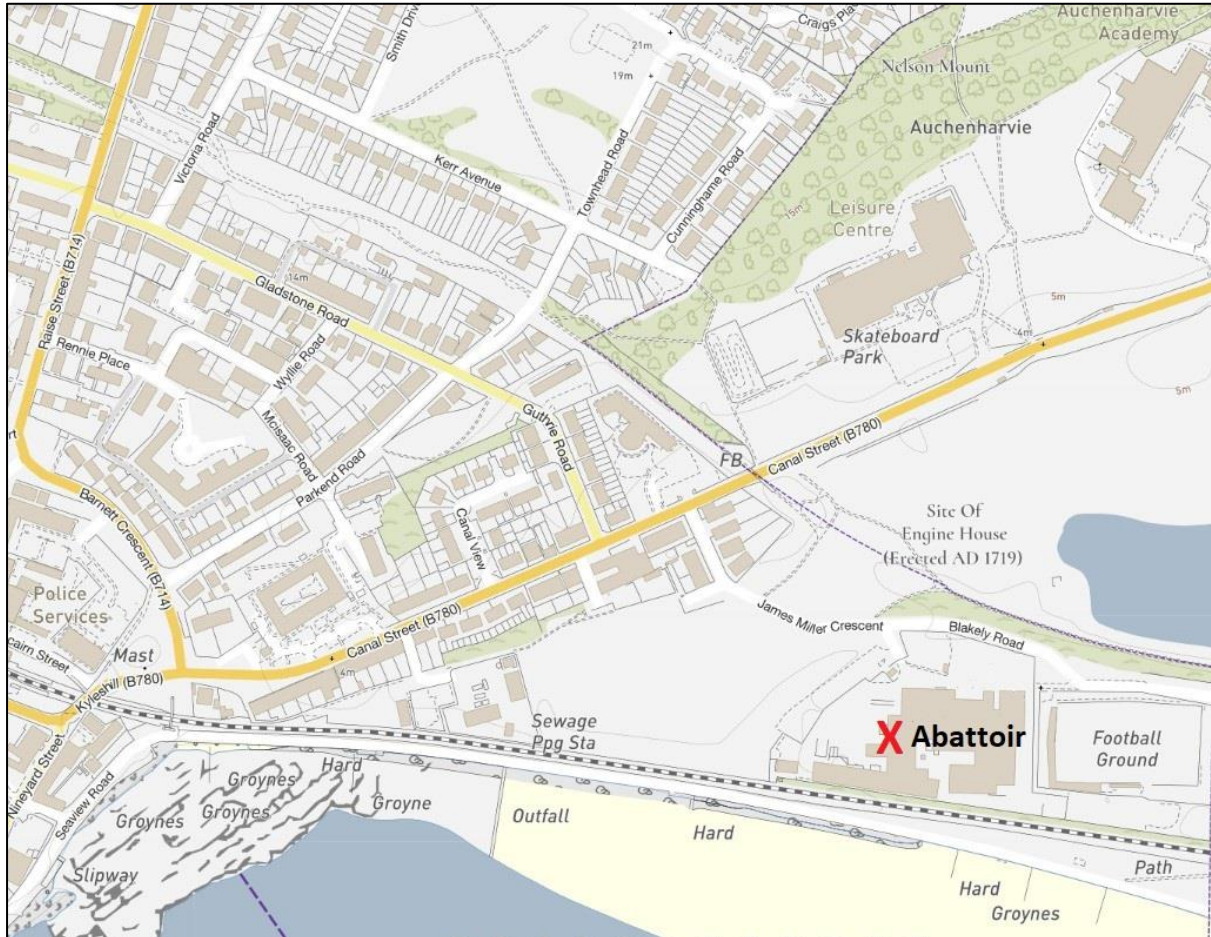

4. Condition 2.4.5 has been deleted and replaced by a new condition 2.4.5, as follows:

2.4.5 The Operator shall prepare, implement and maintain an “Incident Prevention and Mitigation Plan”. detailing the hazards and risks posed by the installation and define steps taken to ensure preventative measures and mitigation are in place. The Incident Prevention and Mitigation Plan shall be reported to SEPA.

5. After Condition 2.4.5, a new Condition 2.4.6 has been added, as follows:

2.4.6 The Incident Prevention and Mitigation Plan must be reviewed at least every 4 years with each review recorded and reported to SEPA.